


# TYPICAL ARRANGEMENT FOR OWS INSTALLATION

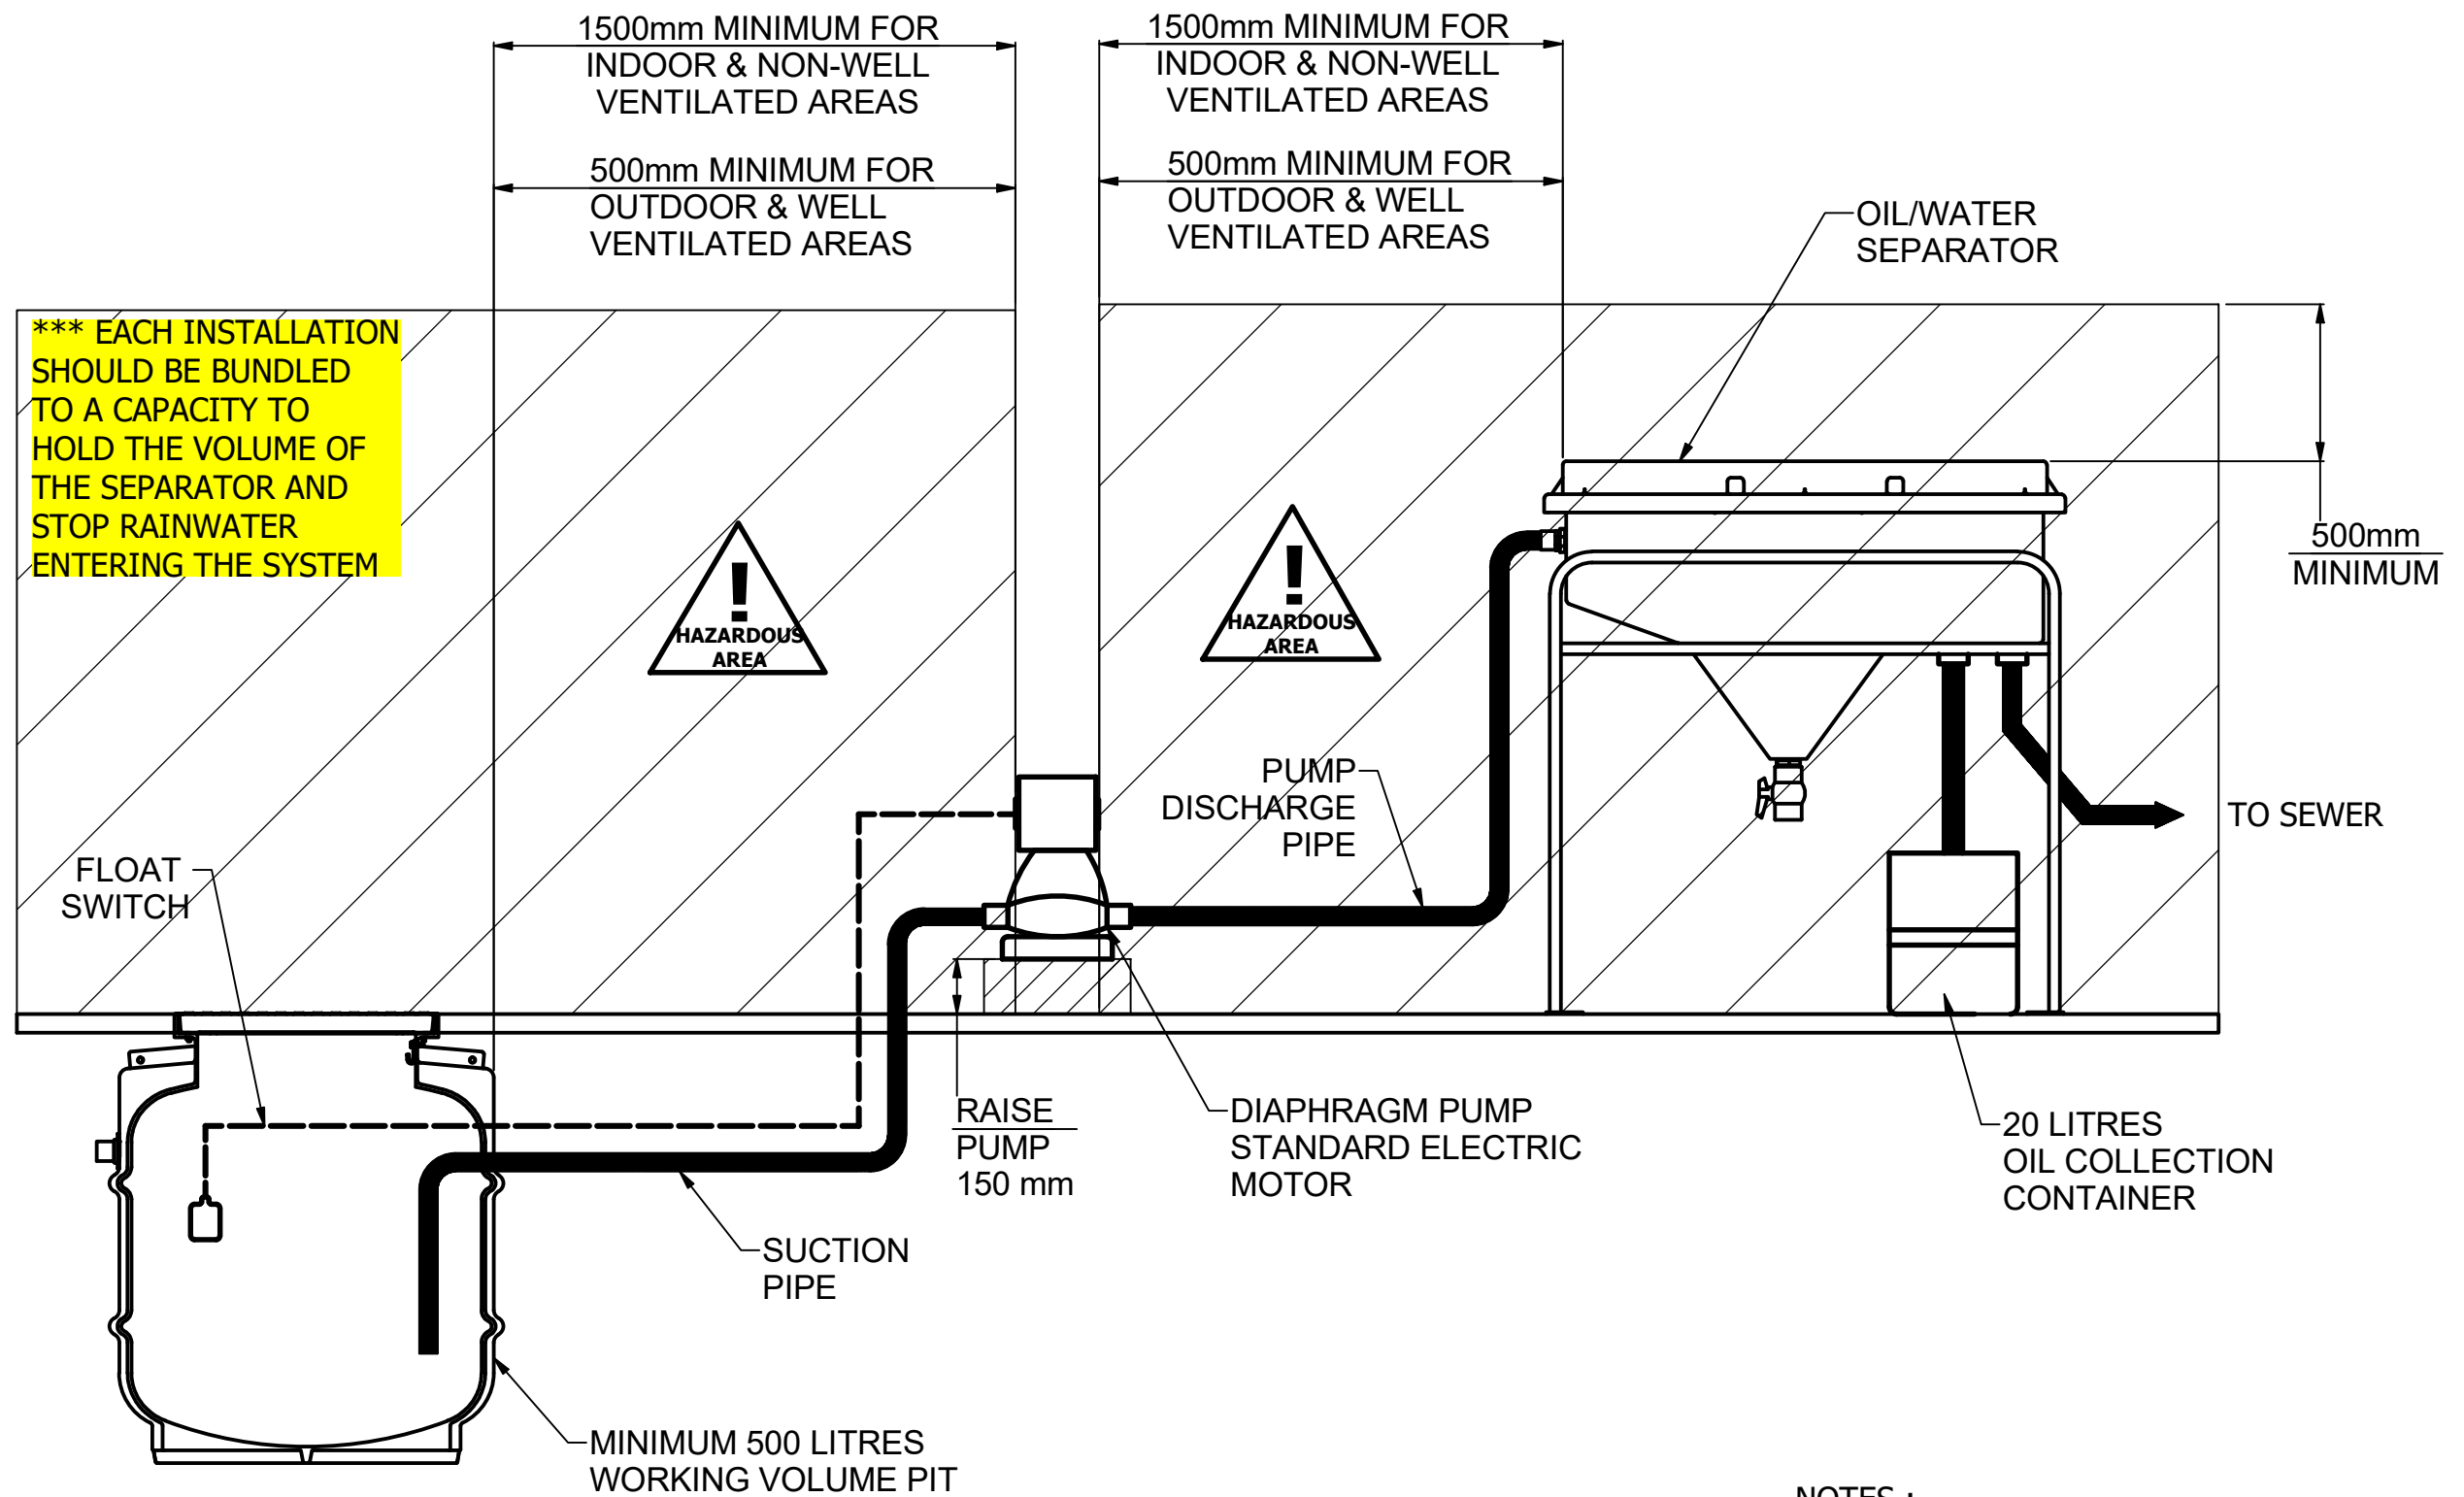

## NOTES :

1. THE SEPARATOR & PIT ARE CLASSIFIED CLASS 1, ZONE 2 AREA
2. FLOAT SWITCH MUST BE OIL PROOF
3. HAZARDOUS AREA EXTENDS 500mm ABOVE SEPARATOR

**4. PUMP & GPO MUST BE MINIMUM 1500mm AWAY FROM HAZARDOUS AREA**